


Observaciones

Table of fire and safety equipment specifications, including fire extinguishers, detectors, and signs, with their respective technical requirements.

Table for fire door specifications, detailing types, fire resistance ratings, and door sizes.

Nota: 1.- Puertas Cortafuego. Las puertas Cortafuego tendrán una resistencia equivalente AL 75% de la resistencia del muro y deberán ser o prueba de humo. Solo se aceptarán puertas aprobadas y certificadas para uso cortafuego.

Table listing fire extinguishers with columns for model, weight, location, and technical specifications.

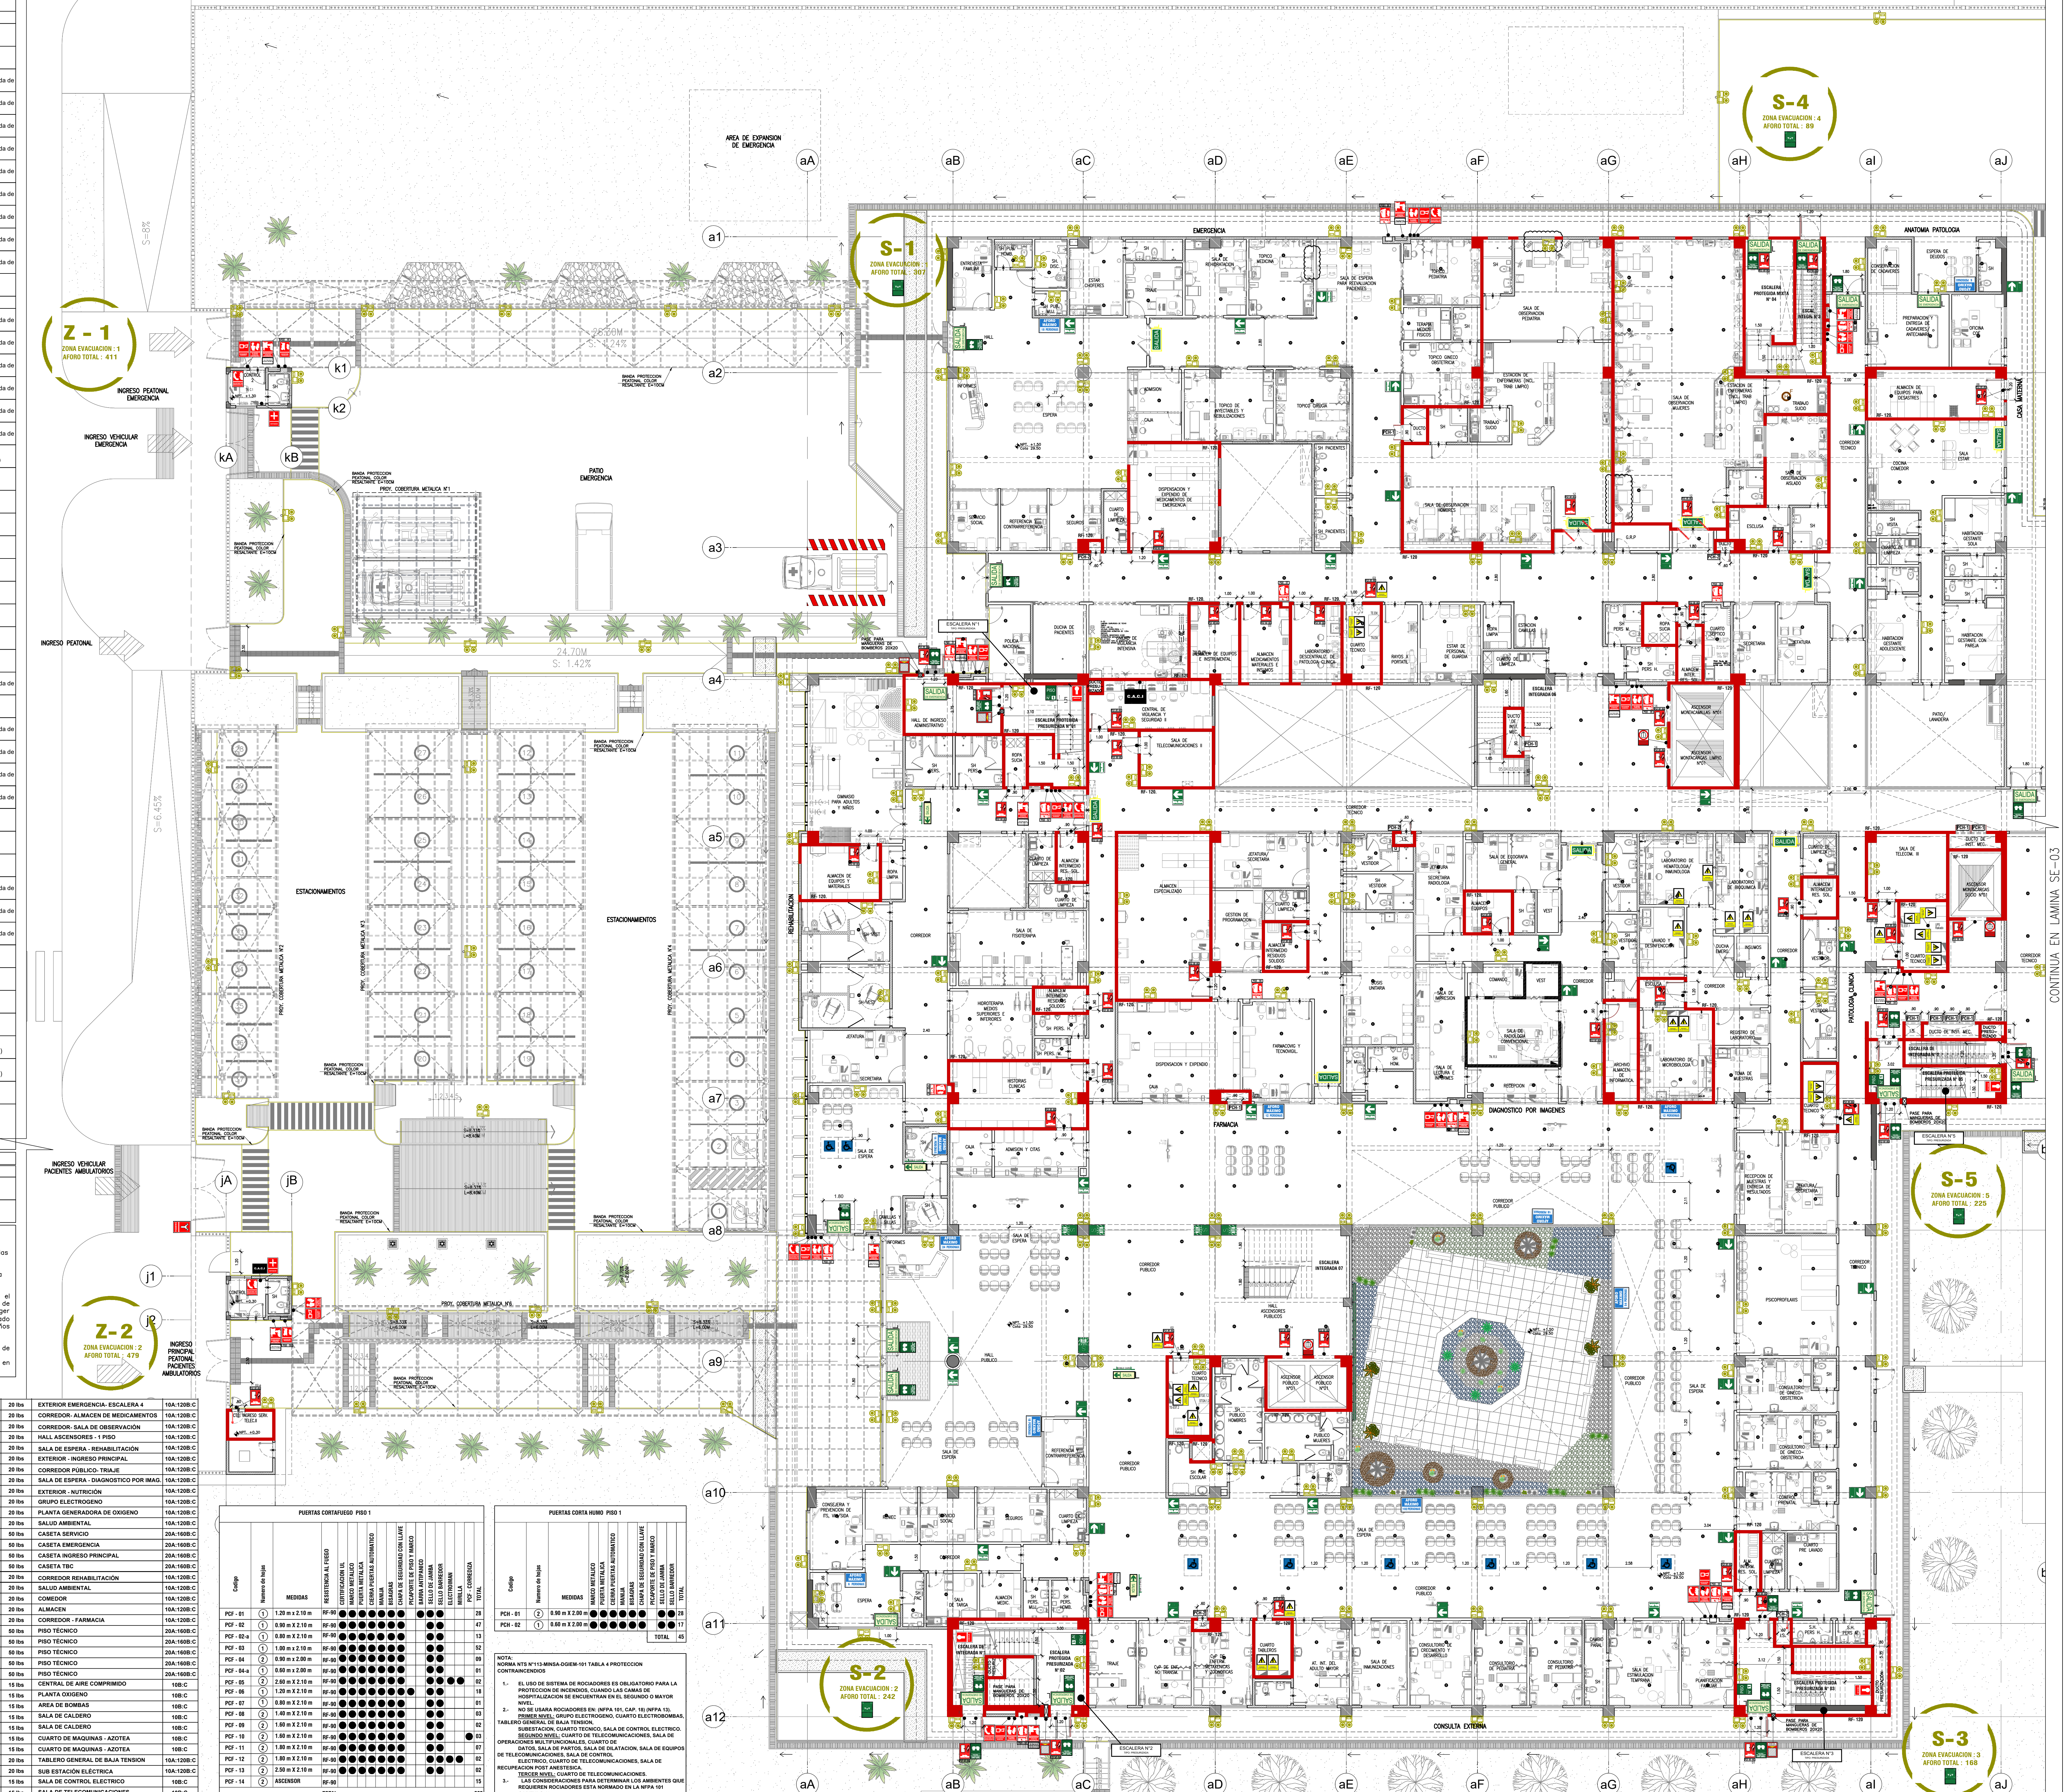

Z-1 ZONA EVACUACION: 1 AFORO TOTAL: 411

S-1 ZONA EVACUACION: 4 AFORO TOTAL: 887

S-4 ZONA EVACUACION: 4 AFORO TOTAL: 89

Z-2 ZONA EVACUACION: 2 AFORO TOTAL: 479

S-2 ZONA EVACUACION: 2 AFORO TOTAL: 242

S-5 ZONA EVACUACION: 5 AFORO TOTAL: 223

CONTINUA EN LAMINA SE-03

Project information block containing fields for project name, architect, engineer, location, and scale.

Table with project details including location (Tumbes), scale (1:125), date (April 2022), and drawing title (SE-02).